


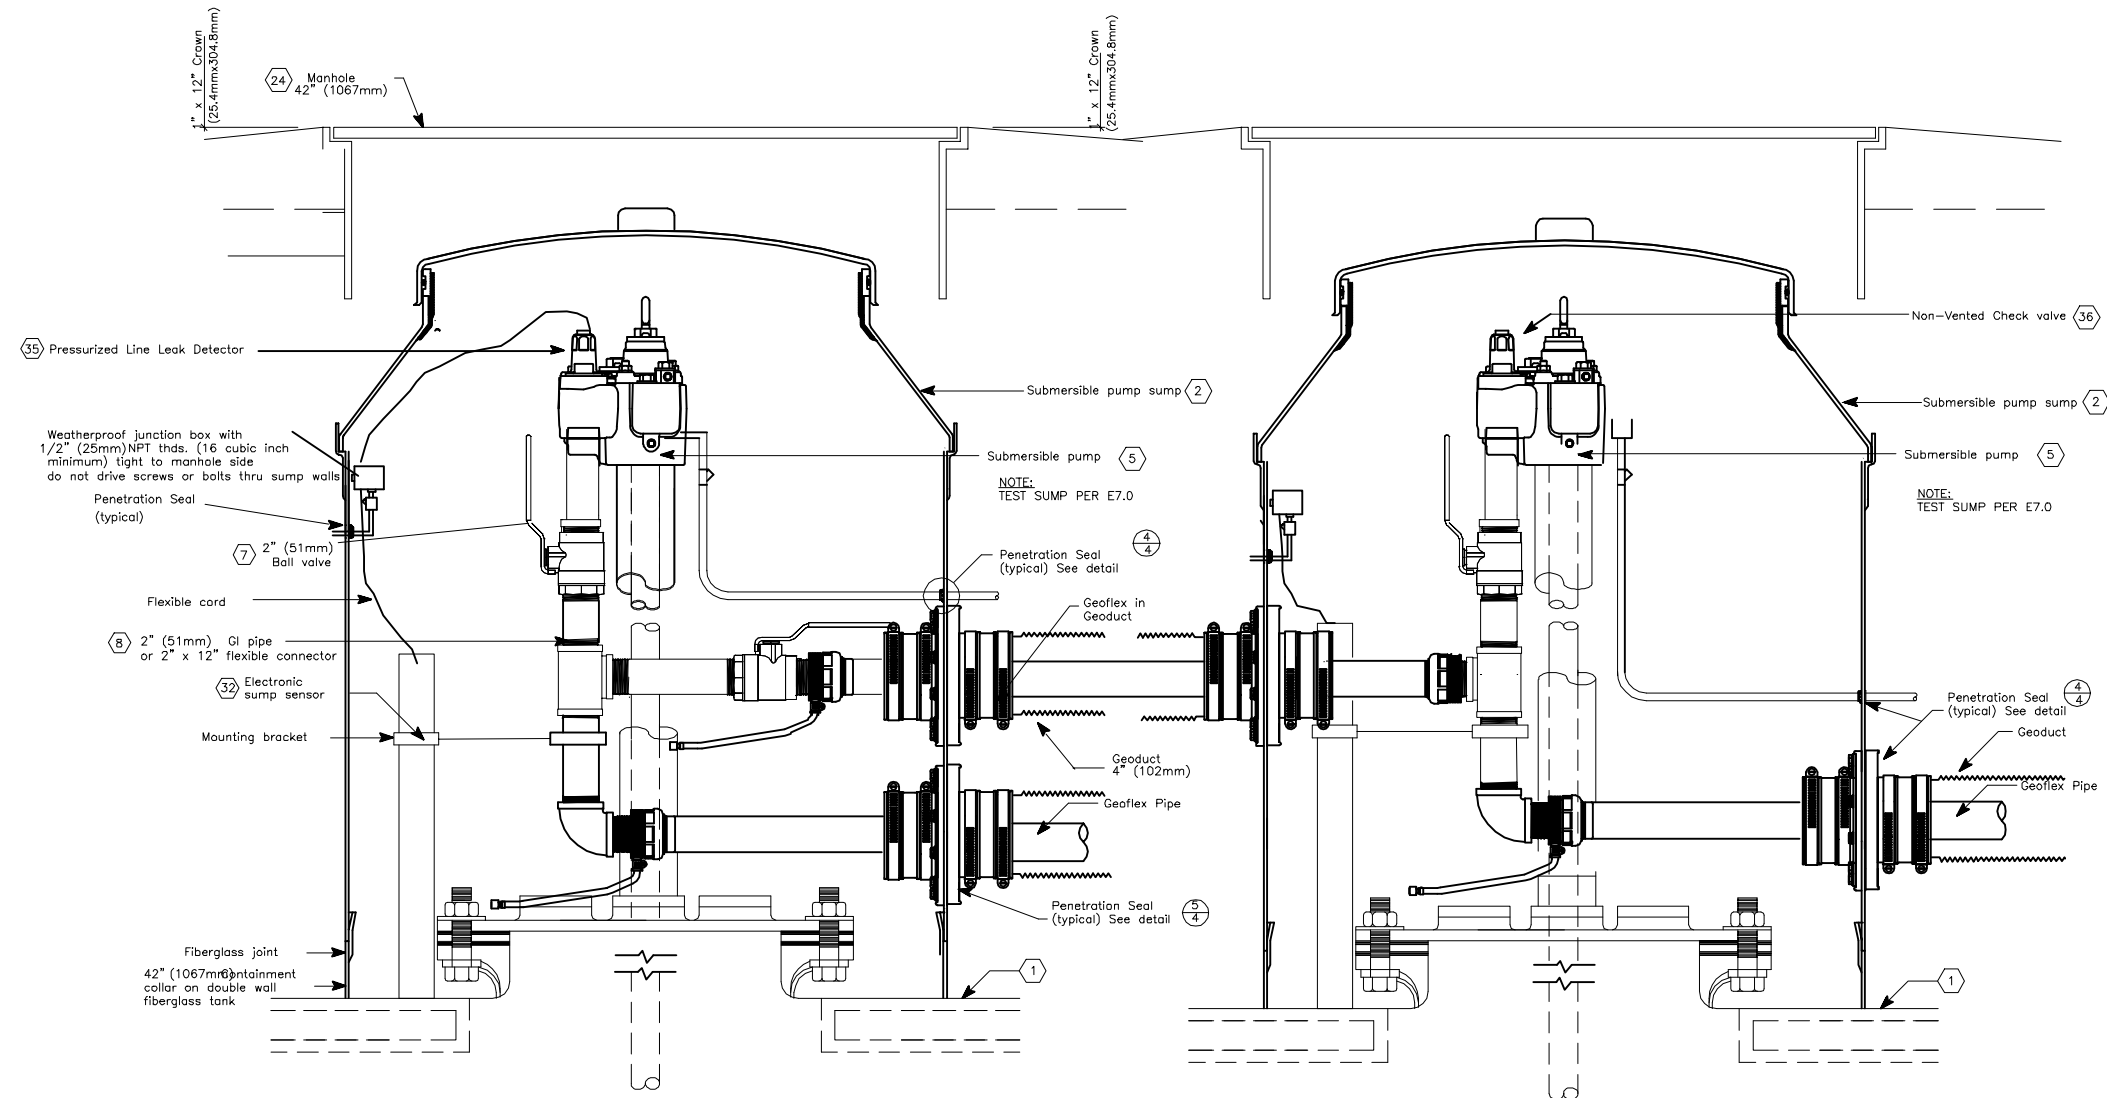

6
5 SUBMERSIBLE PUMP SECTION – RED JACKET

FIBERGLASS PIPING SIMILAR

PUMPS FOR DUAL REGULAR TANKS
NOTE: TANKS ARE NOT SYPHONED

REFER TO P2.0 FOR " " EQUIPMENT DESIGNATION

NOTE:

When more than one pump is used in a single grade pipeline and all pumps discharge into the same pipeline, only one pump will have a pressurized line leak detector. The line leak detector ports in all other pumps serving that same grade and pipeline will have non-vented check valves installed.