



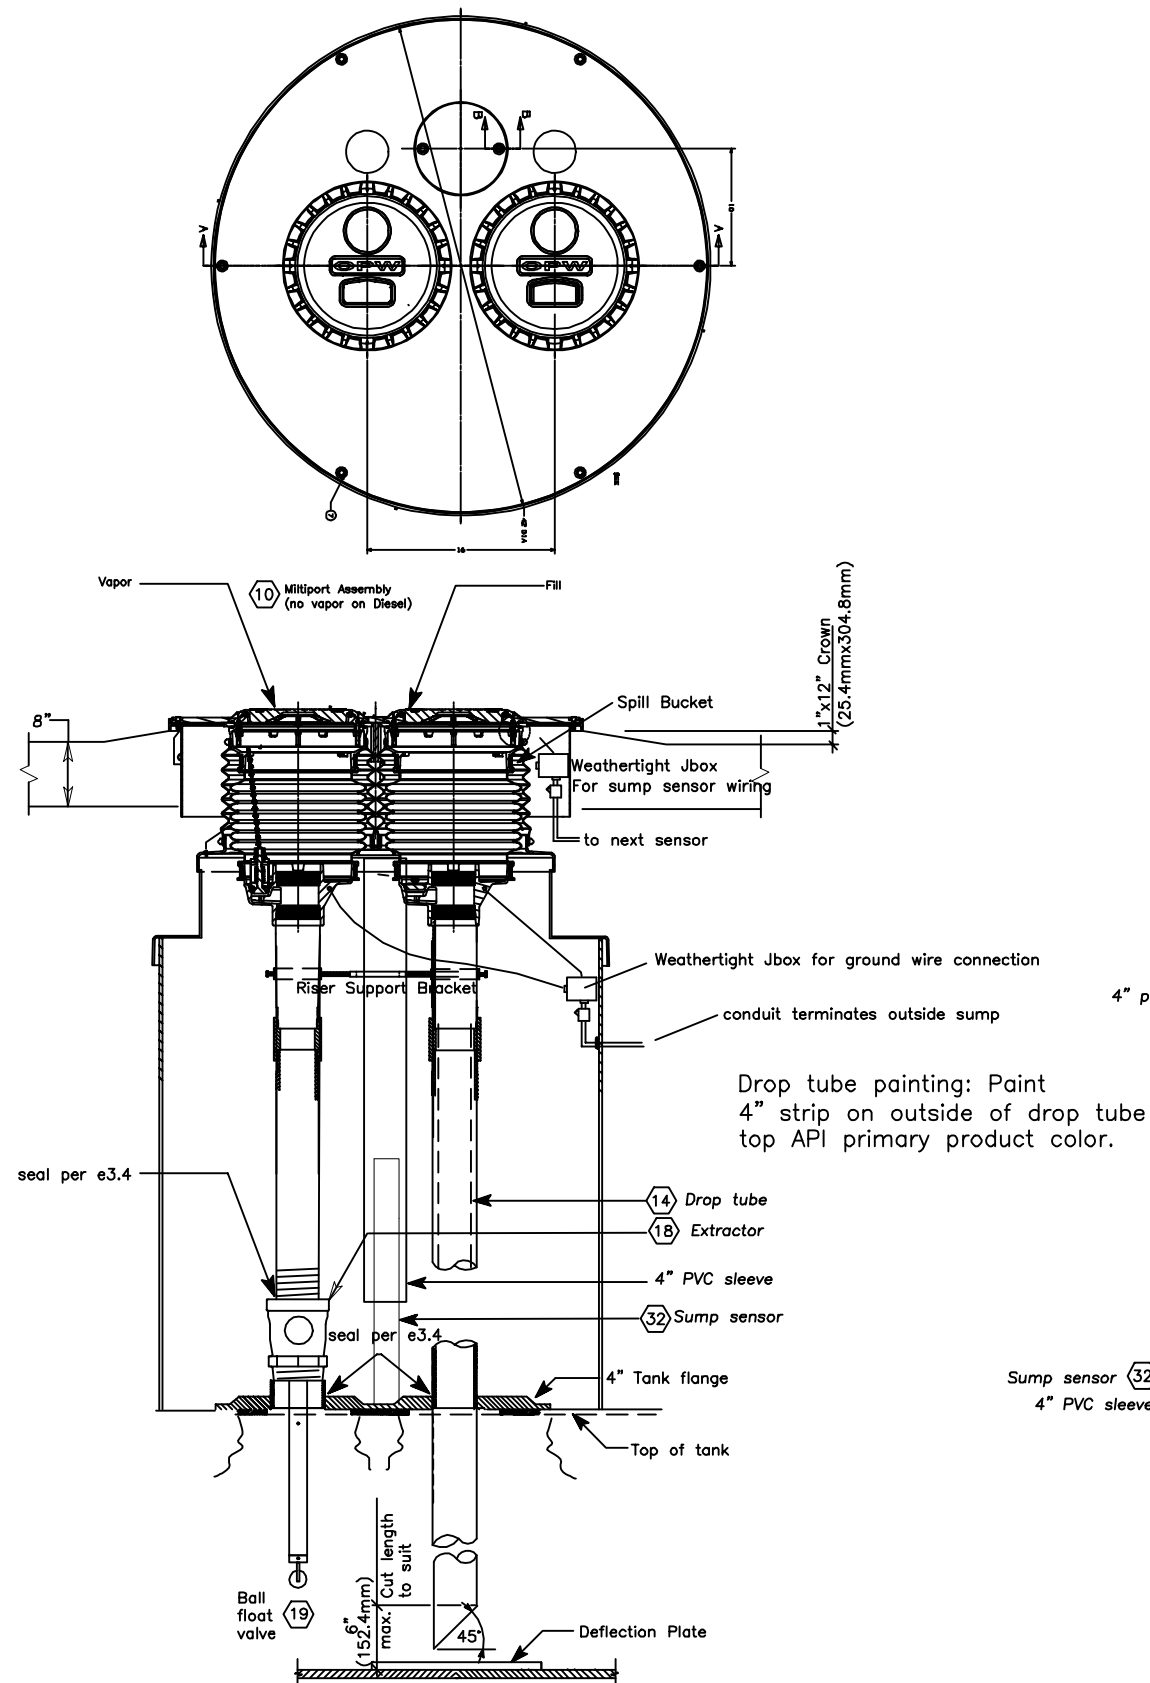

3
8 Multiport 4" FILL and Vapor Section
NOTE:
EXTRACTOR VALVE IS SHOWN
ROTATED 90 ° FOR CLARITY

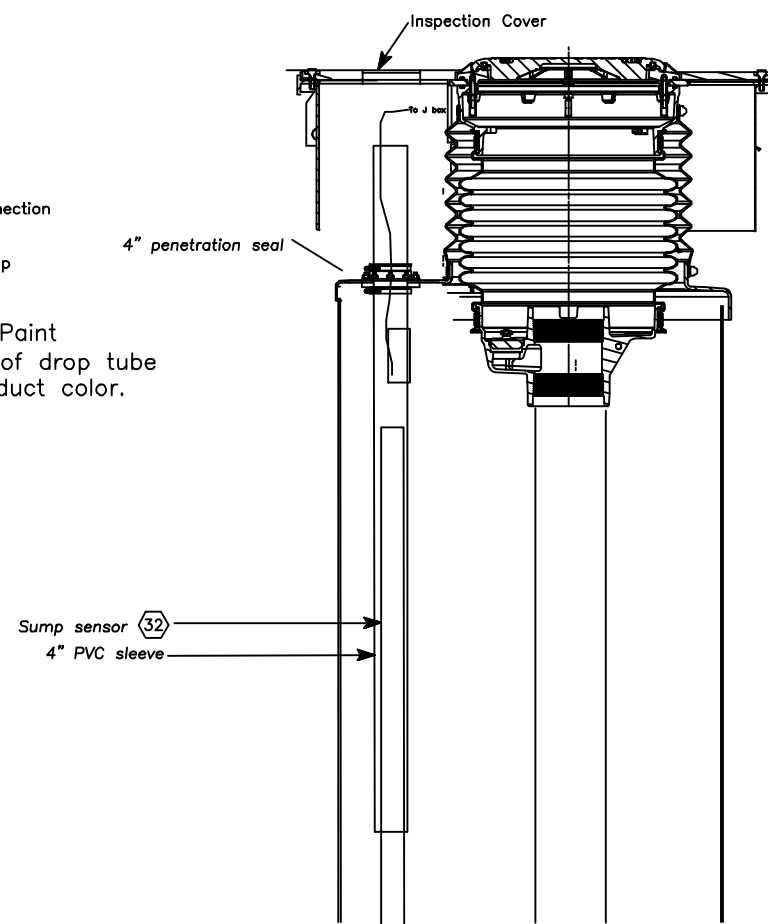

4
8 Multiport 4" FILL and Vapor Section
NOTE: Sump Sensor installation in sleeve

REFER TO P2.0 FOR " " EQUIPMENT DESIGNATION